
AUTOCASHIER



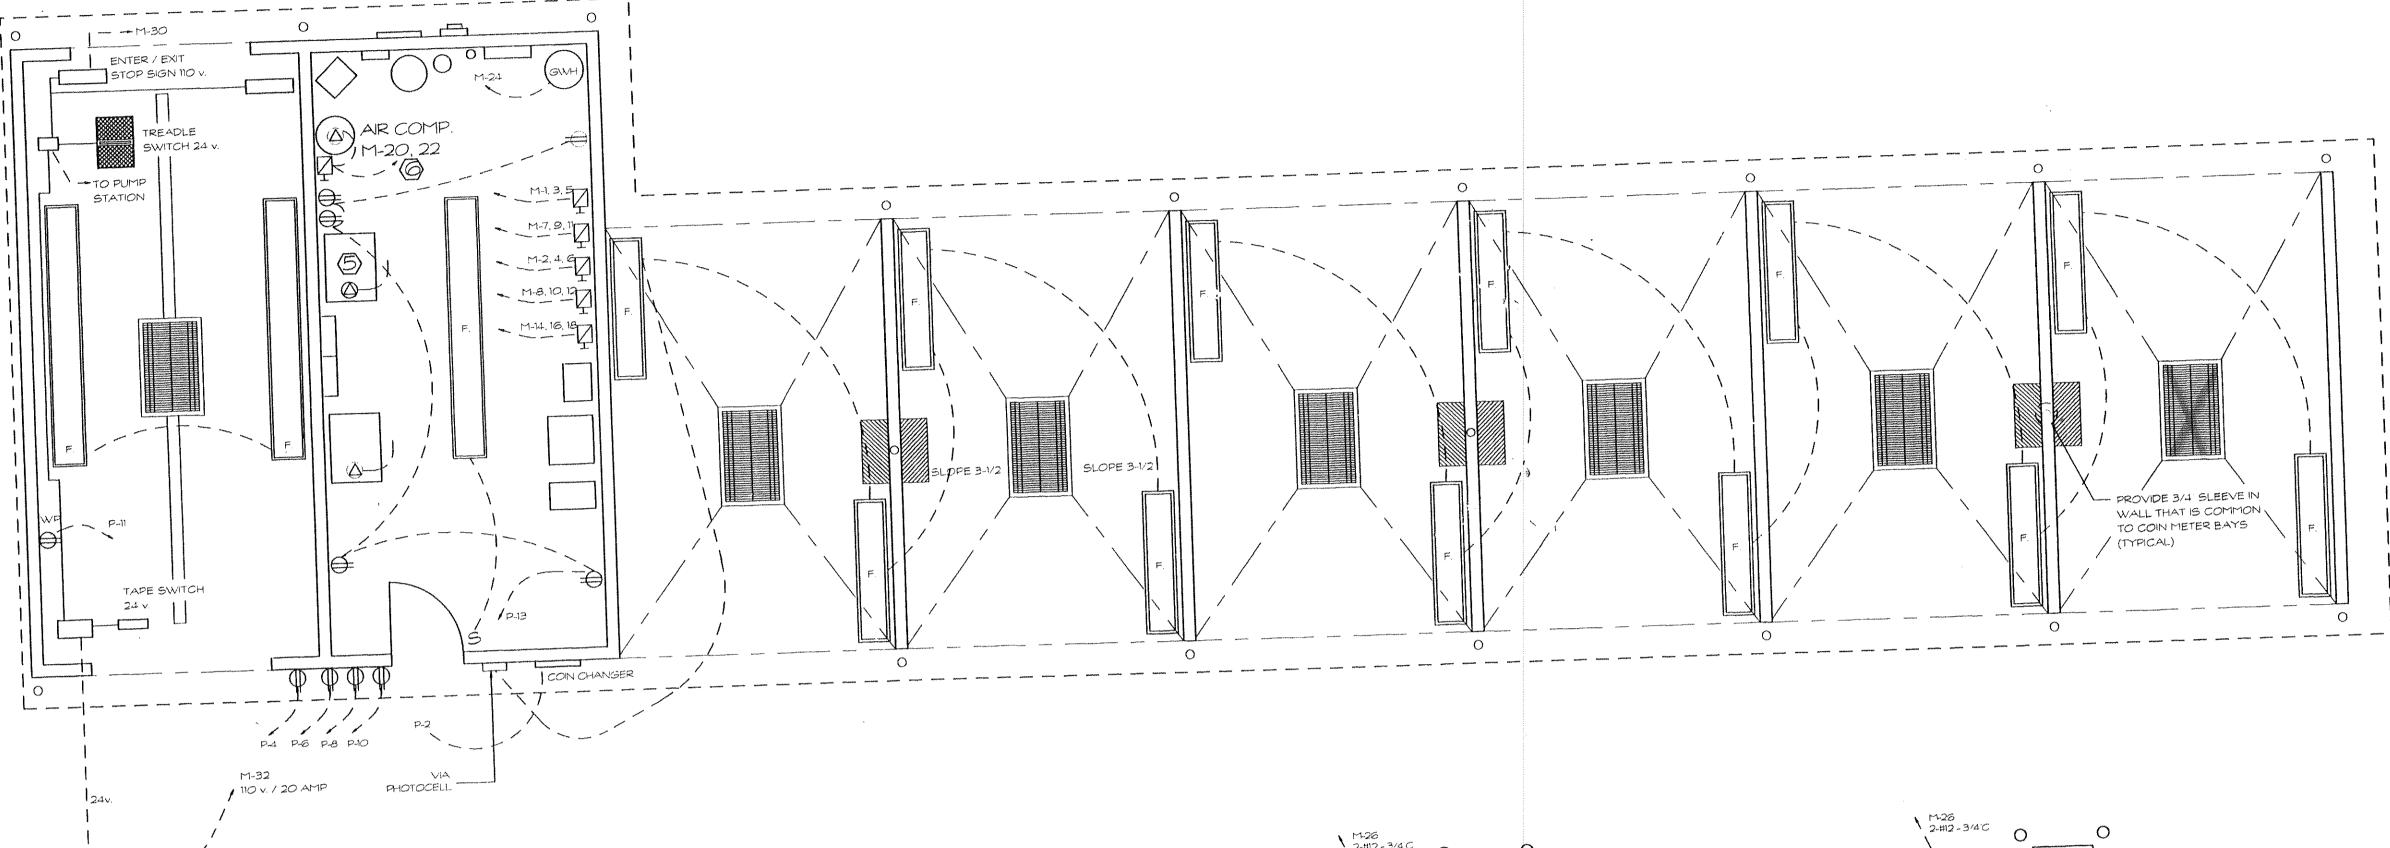


NOTES: 1. USE SCHEDULE 40 PVC CONDUIT. PVC BOXES ALL INSTALLATION OF WET LOCATIONS.

2. REFER TO AUTOMATIC CARWASH
MANUF. / SUPPLIER FOR EXACT LOCATION
OF ALL EQUIPMENT. ALL CONTROL
WIRING, SIGNAL DEVICES, JUNCTION
BOXES, ETC. TO BE AS SPECIFIED BY
AUTOMATIC CARWASH MANUFACTURERS
SHOP DRAWINGS.

3. WP RECEPTACLE COVERS TO BE TYPE APPROVED FOR WET LOCATIONS WITH CORD AND PLUG INSERTED. POLYCARBONATE COVER SIERRA OR APPROVED EQUIV.

- 4. VERIFY LOCATION OF ALL VACUUM ISLANDS.
- 5. PROVIDE 100 AMP, 3 PHASE FUSED SWITCH - FUSE PER UNIT NAMEPLATE.
- 6. PROVIDE 60 AMP, 2 PHASE FUSED SWITCH - FUSE PER UNIT NAMEPLATE.

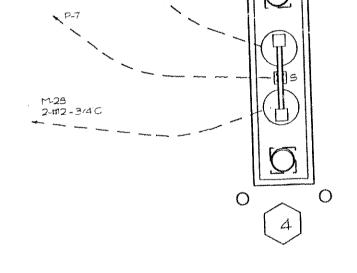7. SEE HANDOUT PROVIDED BY CAR WASH CONCEPTS FOR BREAKER SIZES 

NOTE:
PROVIDE SLEEVES (2 EA.) BACK TO MAIN
PANEL FOR VACUUMS. ADD ONE SLEEVE
FOR LIGHTS WHEN APPLICABLE

TYPICAL ELECTRICAL PLAN

M-26 2-#12-3/4C

M-28 2-#12 - 3/4 C

NOTE: THIS ELECTRICAL PLAI
PROVIDE GENERAL ELECTRIC
FOR BID AND PRICING PURPL
ELECTRICAL CONTRACTOR I
FOR ALL LOAD CALCULATIC
ASSIGNMENTS SHA

THESE DRAWINGS AND THE IMAGES AND INFORMATION CONTAINED HEREIN ARE THE PROPERTY OF CARWASH CONCEPTS AND MAY NOT BE DUPLICATED OR REPRODUCED IN ANY FORM WITHOUT THE WRITTEN PERMISSION OF CARWASH CONCEPTS.

NOTE: THIS ELECTRICAL PLAN IS INTENDED TO PROVIDE GENERAL ELECTRICAL INFORMATION FOR BID AND PRICING PURPOSES ONLY. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR ALL LOAD CALCULATIONS AND PANEL ASSIGNMENTS. THE ELECTRICAL CONTRACTOR SHALL ALSO SEE THAT INSTALLATION FOLLOWS THE REGULATIONS AND PRACTICES SET FORTH IN THE N.E.C. AS WELL AS ANY LOCAL AND STATE BUILDING CODES.

C 50 EAST MAIN STREE

STEVE EVERHART
WINSTON SALEM, N C

) 733-9760

7 (800) 7

East Main Street

С П

> 50 East Thomasvi

> > 336) 475-0522

DATE 2/3/98

DRAWN BY: DAF

SCALE: AS NOTED

REVISED:

APPROVED:

Sheet No.

CWC 5